

## Wellsville Water Treatment Plant

# WATER QUALITY REPORT FOR 2006

Public Water Supply ID# NY 0200327

### INSIDE THIS REPORT:

Facts & Figures	<u>2</u>
Are their contaminants?	<u>2</u>
Why save water?	<u>2</u>
Detected Contaminants	<u>3</u>
Definitions	<u>4</u>
Non-Detected Contaminants	<u>5</u>
Special Precautions?	<u>5</u>
System Improvements	<u>6</u>



Wellsville High School

VISIT THE WATER WEB SITES  
LISTED BELOW

**www.epa.gov/safewater**  
**www.health.state.ny.us**



# www.wellsvillewater.com



To comply with State and Federal regulations, the Wellsville Water Department will be annually issuing a report describing the quality of your drinking water. The purpose of this report is to raise your understanding of drinking water and awareness of the need to protect our drinking water sources. Last year, your tap water met all State drinking water health standards. We are proud to report that our system has never violated a maximum contaminant level or any other water quality statement. This report provides an overview of last year's water quality. Included are details about where your water comes from, what it contains, and how it compares to State standards.

If you have any questions about this report or concerning your drinking water, please contact Dana Harris, treatment plant supervisor, at (585) 593-3333. We want you to be informed about your drinking water. If you want to learn more, please visit our

web site ([www.wellsvillewater.com](http://www.wellsvillewater.com)), or attend any of our regularly scheduled Village board meetings. The meetings are held the 2<sup>nd</sup> and 4<sup>th</sup> Mondays of the month at 7:00 p.m. at the municipal building.



## WHERE DOES OUR WATER COME FROM?

In general, the sources of drinking water (both tap and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and can pick up substances resulting from the presence of animals or from human activities. Contaminants that may be present in source water include: microbial contaminants; inorganic contaminants; pesticides and herbicides; organic chemical contaminants; and radioactive contaminants. In order to ensure that tap water is safe to drink; the State and the EPA prescribe regulations which limit the amount of certain contaminants in water provided by public water systems. The State Health Department's and FDA's regulations establish limits for contaminants in bottled water which must provide the same protection for public health.

The Village of Wellsville's water source is surface water (Genesee River). The water is drawn from the river at our intake located south of the treatment plant. During 2006 our system did not experience any restriction of our water source. The water is pumped

from our intake to the treatment plant. After filtration, disinfection, pH adjustment, fluoridation, and corrosion control treatment, the water is then pumped to our two new 2 million gallon reservoirs which then flows to the businesses and homes.

The New York State Department of Health has completed a source water assessment for this water system. The final report hasn't been published yet. When this becomes available, you may call 593-3333 for a copy.



## FACTS AND FIGURES

Our water system serves 5700 people through 2300 service connections. The total water produced in 2006 was 265 million gallons. The daily average water pumped into the system was 727,018 gallons. Our highest single day was 1,585,000. The amount of water delivered to customers was 188 million gallons; this leaves 77 million gallons of water unaccounted for. (29% of the amount pumped). This unaccounted for water includes water used for flushing mains, fighting fires, fire training, and leaks. In 2006 our water customers were charged \$0.54 per unit of water (1 unit equals 748 gallons) for 1 to 3 units, \$3.68 per unit of water for 4 to 50 units, \$2.54 per unit for 50 to 100 units, \$2.27 per unit for 101 to 150 units, \$1.32 per unit over 150 units. Plus a monthly service charge of \$14.00.

Please visit our web site

[wellsvillewater.com/water\\_rates.htm](http://wellsvillewater.com/water_rates.htm) for a more detailed explanation of the billing charges.



**1 unit equals  
748 gallons of  
water**

[wellsvillewater.com/  
water\\_rates.htm](http://wellsvillewater.com/water_rates.htm)

## Are there contaminants in our drinking water?

As the State regulations require, we routinely test your drinking water for numerous contaminants. These contaminants include: total coliform, turbidity, inorganic compounds, nitrate, nitrite, lead, copper, volatile organic compounds, total trihalomethanes, radiological, and synthetic organic compounds. The table of detected contaminants included with this report depicts which compounds were detected in your drinking water. For further information on all of the contaminants tested and their results see the list on pages 3 & 5 or visit our web site. The State allows us to test for some contaminants less than once per year because the concentrations of these contaminants do not change

frequently. Some of our data though representative, are more than one year old.

It should be noted that all drinking water, including bottled drinking water, might be reasonably expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the EPA's Safe Drinking Water Hotline at (800) 426-4791 or the Allegany County Department of Health at (585) 268-9250.

**For all of our  
current lab  
results, visit  
our web site**

[wellsvillewater.com/  
lab\\_results.htm](http://wellsvillewater.com/lab_results.htm)

## Why save water and how to avoid wasting it?

- • • • • • • • • • •
- Although our system is very fortunate to have an adequate amount of water to meet present and future demands, there are a number of reasons why it is important to conserve water:
- Saving water saves energy and some of the costs associated with both of these necessities of life.
- Saving water reduces the cost of energy required to pump water.
- Saving water lessens the strain on water systems during a dry spell or drought, helping to avoid severe water use restrictions so that essential fire fighting needs are met.
- • • • • • • • • • •

**You can play a role in conserving water** by becoming conscious of the amount of water your household is using, and by looking for ways to use less whenever you can. It is not hard to conserve water.

### Conservation tips include:

- Dishwashers use 15 gallons for every cycle, regardless of how many dishes are loaded. So load it to capacity every time.
- Check every faucet in your home for leaks. Just a slow drip can waste 15 to 20 gallons a day. Fix it and you can save almost 6,000 gallons per year.
- Check your toilets for leaks by putting a few drops of food coloring in the tank, watch for a few minutes to see if the color shows up in the bowl. It is not uncommon to lose up to 100 gallons a day from one of the otherwise invisible toilet leaks. Fix it and you can save more than 30,000 gallons per year.



- Use water-saving, flow-restricting shower heads and low flow faucets (aerators).
- Use your water meter to detect hidden leaks. Simply turn off all taps and water using appliances. Check your meter reading, and then check again after 15 minutes, if it moved, you have a leak. Most of our meters have a leak detector dial in the middle of them (usually a white arrow), that if turning when everything is off signifies a leak.
- Don't cut your lawn too short, longer grass saves water.
- Water your lawn after 6:00 pm, this prevents water loss due to evaporation.
- When washing your car don't let the hose run continuously.
- When brushing your teeth, shaving or shampooing avoid running the water unnecessarily.
- Water your garden and lawn only when necessary. Remember that a layer of mulch in the flower beds and garden is not only aesthetically pleasing but will help

**For More Tips visit our web site**

[wellsvillewater.com/tips\\_problems.htm](http://wellsvillewater.com/tips_problems.htm)

### TABLE OF DETECTED CONTAMINANTS

CONTAMINANT	VIOLATION YES/NO	DATE OF SAMPLE	LEVEL DETECTED (RANGE)	LEVEL OF MEASUREMENT	MCLG	REGULATORY LIMIT	LIKELY SOURCE OF CONTAMINATION
<b>Microbiological Contaminants:</b>							
Turbidity <sup>2</sup>	NO	01/29/ 2006	0.33 (0.03–0.33)	NTU	N/A	TT 0.3	Soil Runoff
<b>Radiological Contaminants:</b> No Contaminants detected – 06/04/2000 (every eight years)							
<b>Inorganic Contaminants:</b>							
Barium	NO	01/10/ 2006	0.040	mg/l	2	MCL 2	Discharge of drilling wastes; metal refineries; natural deposits.
Chloride	NO	08/03/ 2006	25.4 (4.5-25.4)	mg/l	N/A	MCL 250	Naturally occurring or road salt contamination.
Chromium	NO	01/10/ 2006	1.0	ug/l	100	100	Discharges from steel mills; natural deposits
Copper <sup>3</sup>	NO	7/12/ 2004	0.14 (0.023–0.18)	mg/l	1.3	AL 1.3	Corrosion of galvanized pipes; natural deposits.
Fluoride	NO	09/08/ 2006	1.79 (0.52-1.79)	mg/l	N/A	MCL 2.2	Natural deposits; water additive that promotes strong teeth.
Lead <sup>4</sup>	NO	7/12/ 2004	7.9 (ND-13)	ug/l	0	AL 15	Corrosion of household plumbing systems; natural deposits.
Nitrate	NO	01/10/ 2006	1.40	mg/l	10	MCL 10	Runoff from fertilizer use; natural deposits.
Sodium	NO	01/10/ 2006	9.6	mg/l	N/A	N/A	Naturally occurring
Sulfate	NO	01/10/ 2006	6.00	mg/l	N/A	MCL 250	Naturally occurring.
Zinc	NO	01/10/ 2006	0.010	mg/l	5	N/A	Naturally occurring
<b>Synthetic Organic Chemicals (Pesticides / Herbicides)</b> No Contaminants detected – 10/11/2005							
<b>Volatile Organic Contaminants:</b> No Contaminants detected – 01/10/2006							
<b>Disinfection Byproducts:</b>							
HAA5 <sup>5,7</sup>	NO	11/08/ 2006	23.38 (0.02-44.00)	ug/l	N/A	MCL 60	By product of drinking water chlorination.
Total Trihalomethanes <sup>6,7</sup>	NO	08/09/ 2006	42.18 (16.50-78.70)	ug/l	N/A	MCL 80	By product of drinking water chlorination.
<b>Total Organic Compounds: Disinfection byproduct precursor</b>							
Entry Point <sup>7</sup>	NO	11/14/ 2006	1.3 (1.1-1.7)	mg/l	N/A	TT 35% removal	Disinfection byproduct precursor
Source <sup>7</sup>	NO	11/14/ 2006	2.2 (1.6-2.7)	mg/l	N/A	N/A	Disinfection byproduct precursor

**What does this information mean?**

As you can see from the table of detected contaminants, our system had no violations. We have learned through our testing that some contaminants have been detected; however, these contaminants were detected below the level allowed by the State.

**Footnotes:**

**1-** A violation occurs in systems collecting less than 40 samples per month when two or more samples are total coliform positive.

**2-** Turbidity is a measure of the cloudiness of the water. We test it because it is a good indicator of the effectiveness of our filtration system. Our highest single turbidity measurement for the year occurred on 10/12/2006. State regulations require that turbidity must always be below 0.3 NTU. 100% of our samples met this turbidity performance standard.

**3 -** The level presented represents the 90<sup>th</sup> percentile of the 20 sites tested. A percentile is a value on a scale of 100 that indicates the percent of a distribution that is equal to or below it. The 90<sup>th</sup> percentile is equal to or greater than 90% of the copper values detected at your water system. In this case 20 samples were collected at your water system and the 90<sup>th</sup> percentile value was the 18<sup>th</sup> highest value (0.19 mg/l). The action level for copper was not exceeded at any of the sites tested.

**4 -** The level presented represents the 90<sup>th</sup> percentile of the 20 sites tested. The action level for lead was exceeded at one of the sites tested.

**5-** HAA5's (mono-,di, & trichloroacetic acid, and mono-, & dibromoacetic acid)

**6 -** Total Trihalomethanes (TTHM's - chloroform, bromodichloromethane, dibromochloromethane, and bromoform)

**7-**This level represents the annual quarterly average calculated from data collected.

**Definitions:**

**Maximum Contaminant Level (MCL):** The highest level of a contaminant that is allowed in drinking water. MCLs are set as close to the MCLGs as feasible.

**Maximum Contaminant Level Goal (MCLG):** The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

**Action Level (AL):** The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements that a water system must follow.

**Treatment Technique (TT):** A required process intended to reduce the level of a contaminant in drinking water.

**Non-Detects (ND):** Laboratory analysis indicates that the constituent is not present.

**Nephelometric Turbidity Unit (NTU):** A measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

**Milligrams per liter (mg/l):** Corresponds to one part of liquid in one million parts of liquid (parts per million - ppm).

**Micrograms per liter (ug/l):** Corresponds to one part of liquid in one billion parts of liquid (parts per billion - ppb).




*For a complete laboratory results listing visit our web site*

[wellsvillewater.com/lab\\_results.htm](http://wellsvillewater.com/lab_results.htm)



**NON-DETECTED CONTAMINANTS  
2006**

1,1,1,2-Tetrachloroethane	Antimony	Isopropylbenzene	trans-1,3-Dichloropropene
1,1,1-Trichloroethane	Aroclor	M-xylene	Trichloroethene
1,1,2,2-Tetrachloroethane	Arsenic	Manganese	Trichlorofluoromethane
1,1,2-Trichloroethane	Atrazine	Mercury	Vinyl chloride
1,1-Dichloroethane	Benzene	Methylene chloride	
1,1-Dichloroethene	Beryllium	MTBE	
1,1-Dichloropropene	Bromobenzene	n-Butylbenzene	
1,2,3-Trichlorobenzene	Bromochloromethane	Nickel	
1,2,3-Trichloropropane	Bromomethane	O-Xylene	
1,2,4-Trichlorobenzene	Cadmium	n-Propylbenzene	
1,2,4-Trimethylbenzene	Carbon Tetrachloride	P-Xlene	
1,2-Dichlorobenzene	Chlorobenzene	sec-Butylbenzene	
1,2-Dichloroethane	Chloroethane	Selenium	
1,2-Dichloropropane	Chloromethane	Silver	
1,3,5-Trimethylbenzene	cis-1,2-Dichloroethene	Simazine	
1,3-Dichlorobenzene	cis-1,3-Dichloropropene	Styrene	
1,3-Dichloropropane	Cyanide	tert-Butylbenzene	
1,4-Dichlorobenzene	Dibromomethane	Tetrachloroethene	
2,2-Dichloropropane	Dicamba	Thallium	
2-Chlorotoluene	Dichlorodifluoromethane	Toluene	
3-Hydroxycarbofuran	Ethylbenzene	Toxaphene	
4-Chlorotoluene	Hexachlorobutadiene	trans-1,2-Dichloroethene	
4-isopropyl tolueene	Iron		

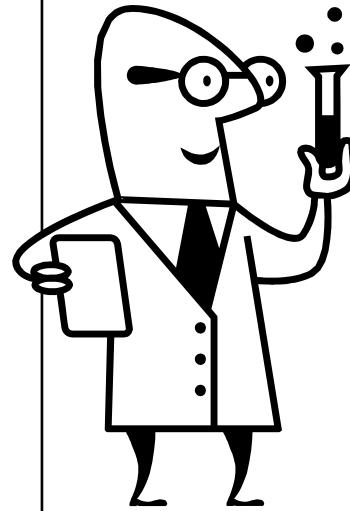

## Do I need to take special precautions?

Although our drinking water met or exceeded State and Federal regulations, some people may be more vulnerable to disease causing microorganisms or pathogens in drinking water than the general population. Immuno-compromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune sys-

tem disorders, some elderly, and infants can be particularly at risk from infections. These people should seek advice from their health care provider about their drinking water. EPA/CDC guidelines on appropriate means to lessen the risk of infection by Cryptosporidium, Giardia and other microbial pathogens are available from the Safe Drinking Water Hotline (800) 426-4791.

Our goal is to provide you with a reliable, safe and adequate supply of water. We take this responsibility very seriously. We will always adhere to all Local,



**Wellsville Water Treatment Plant**

111 W. State St.  
Wellsville, NY 14895

Tel: 585-593-3333  
Fax: 585-593-5864  
dana@wellsvillewater.com



We're on the WEB  
[www.wellsvillewater.com](http://www.wellsvillewater.com)



\*\*\*\*\*  
\* System Improvements.\*  
\*\*\*\*\*

**2006:**

- Received National Rural Water Associations "Excellence in Environmental Achievement" award for cleaning up along a portion of our watershed.
- All of our certified operators attended courses to remain up to date on all new rules, regulations and State requirements.
- Continuously updating our web site to keep our consumers up to date.
- Submitted all required lab tests and the results are posted on our website. This includes the new disinfection byproduct monitoring rule requirements.
- Exercised main water line valves.
- Installed new components to our security systems throughout.
- Conducted watershed survey and submitted to Department of Health.
- Updated emergency plan and submitted to Department of Health.
- Replaced service lines in portions of our service area.
- Install a pump station at the reservoir sites to supply residents of Sunset Ave. and Lee Place with a minimum of 50# pressure.
- Replaced out dated fire hydrants.
- Replaced 700 feet of 2" galvanized line on upper Madison St..
- Conducted leak survey and repaired leaks that were found.

**2007:**

- Install security fencing and lighting around our finished water reservoirs.
- Continue working on the source water protection program.
- Continue to remain up to date on all new rules & regulations.
- Add to and update our Security systems.
- Flush system twice, once in May the other in September.
- Install new mains on Sunset, Windover East and Lee place in connection with the new pump station.
- Bore under state route 417 east to repair main line leak.

Thank you for allowing us to continue to provide your family with quality drinking water this year. We ask that all our customers help us to protect our water sources, which are the heart of our community and our way of life. Please call the water treatment plant at (585) 593-3333 or e-mail me at [dana@wellsvillewater.com](mailto:dana@wellsvillewater.com) if you have any questions. Please visit our web site periodically as it is updated as new information becomes available. [www.wellsvillewater.com](http://www.wellsvillewater.com)

Dana L. Harris  
Water Treatment Plant Supervisor